

தமிழ்நாடு தீயணைப்பு - மீட்புப்பணித்துறை.

படிவம்-41

ஆணை எண்.250(3)

வ.எண் :- 42/2021.
ஒ.மு.எண்:-2352/ஆ/2021.
நாள்:- 01.06.2021.

மாவட்ட அலுவலர் அலுவலகம்,
தீயணைப்பு மீட்பு பணித்துறை,
பெரம்பலூர் மாவட்டம் - பெரம்பலூர்.

தடையின்மைச்சான்று

பொருள்:- தீயணைப்பு - மீட்புப்பணித்துறை - பெரம்பலூர் மற்றும் அரியலூர் ஒருங்கிணைந்த மாவட்டம் - திருச்சிராப்பள்ளி மாவட்டம் - துறையூர் வட்டம் - துறையூர் - சர்வே எண்:-314/12,314/13,314/14,314/15 அபிவிமங்கலம் கிராமம், புத்தனாம்பட்டி அஞ்சல், துறையூர் வட்டம், திருச்சிராப்பள்ளி மாவட்டம் என்ற முகவரியில் செயல்பட்டு வரும் M/s நேரு நினைவு கல்லூரி - முதுகலை கணிணி பயன்பாட்டியல் (MCA) மற்றும் முதுநிலை வணிக மேலாண்மை பாடப்பிரிவு (MBA) கல்லூரியை ஆய்வு செய்து தடையின்மைச்சான்று வழங்குவது - தொடர்பாக.

பார்வை:- 19.05.2021 நாளிட்ட தங்களது விண்ணப்பம்.

திருச்சிராப்பள்ளி மாவட்டம் - துறையூர் வட்டம், அபிவிமங்கலம் கிராமம், புத்தனாம்பட்டி அஞ்சல், சர்வே எண்:- 314/12,314/13,314/14,314/15 என்ற முகவரியில் செயல்பட்டுவரும் M/s நேரு நினைவு கல்லூரி - முதுகலை கணிணி பயன்பாட்டியல் (MCA) மற்றும் முதுநிலை வணிக மேலாண்மை பாடப்பிரிவு (MBA) கல்லூரியை பெரம்பலூர் மாவட்ட அலுவலரால் 28.05.2021 அன்று ஆய்வு மேற்கொள்ளப்பட்டு தடையின்மைச்சான்று வழங்க பரிந்துரை செய்துள்ளார். மேற்கண்ட பரிந்துரையின் பேரில் கீழ்க்கண்ட நிபந்தனைகள் நிறைவேற்றப்பட வேண்டும் என்ற அடிப்படையில் தீயணைப்பு மீட்பு பணிகள் துறையின் “தடையின்மைச்சான்று” வழங்கப்படுகிறது.

நிபந்தனைகள்

1. விண்ணப்பதாரர் இது தொடர்பான தேவையான அனுமதி தடையின்மை சான்றினை சம்பந்தப்பட்ட உரிமம் வழங்கும் பிறகுறை அதிகாரியிடமிருந்து பெறவேண்டும்.
2. கட்டியிருக்கும் கட்டிடத்தில் ஏதேனும் மாற்றங்கள் செய்தாலோ அல்லது கூடுதலாக தளங்கள் கட்டினாலோ அதற்கு தனியாக விண்ணப்பித்து அனுமதி பெறவேண்டும்.
3. இந்திய தரக்கட்டுப்பாடு IS:2190:2010 ஏற்ப தீயணைப்பாளர்கள் பொருத்தப்படவேண்டும்.
4. மனித சக்தியால் இயங்கக்கூடிய மின்சார தீ எச்சரிக்கை ஒலி சாதனம் அமைக்கப்பட வேண்டும்.
5. வெளியேறும் வழிகள், தப்புவிக்கும் வழிகள், அவசர கால வழிகள் அனைத்தும் இந்திய தேசிய கட்டிட நெறிமுறை 2016 Part IV- இன்படி அமைக்கப்படவேண்டும்.
6. தேவையான இடத்தில் Self glowing exit signage அமைக்கப்படவேண்டும்.
7. கட்டிடத்தின் உள்ளே எளிதில் தீப்பற்றும் பொருட்கள் சேமித்து வைக்கக்கூடாது.
8. தீப்பாதுகாப்புக்கென 10000 லிட்டர் மேல்நிலைத்தொட்டி மற்றும் 450 LPM நீரை வெளியேற்றும் திறன் கொண்ட மேல்நிலை :பயர் பம்பு அமைக்கப்பட வேண்டும்.

ஹோஸ் ரீல் சிஸ்டம் பொருத்தப்படவேண்டும்.



பொருள்:- M/s நேரு நினைவு கல்லூரி ,
அபிவிமங்கலம் கிராமம், புத்தனாம்பட்டி அஞ்சல் ,
துறையூர் வட்டம்,
திருச்சிராப்பள்ளி மாவட்டம் - 621007.
நகல்:- துணை இயக்குநர், தீயணைப்பு மீட்பு பணிகள் துறை, மத்திய மண்டலம், திருச்சி.

U. Jayaraj
மாவட்ட அலுவலர்,
தீயணைப்பு மீட்பு பணிகள்,
பெரம்பலூர் மாவட்டம்,
பெரம்பலூர்.

TAMIL NADU FIRE AND RESCUE SERVICE

Form - 41

Order No.250 (3)

S.No.42/2021
R.C.No.2352/A/2021
Date: 01.06.2021

District Officer's Office
Fire Rescue
Department
Perambalur District
Perambalur District
Perambalur.

NO OBJECTION CERTIFICATE

Sub	:	Fire Rescue - Rescue Service - Perambalur and Ariyalur Integrated Districts- Tiruchirappalli District - Thuraiyur Taluk - Thuraiyur - Survey No.314/12, 314/13, 314/14, 314/15 operating at Abinimangalam Village, Puthanampatti (PO). Thuraiyur Taluk, Tiruchirappalli District, M/s.Nehru Memorial College - to inspect MCA & MBA College and issue of No Objection Certificate - reg.
Ref	:	Your letter dated 19.05.2021 *****

Tiruchirappalli District, Thuraiyur Taluk, Abinimangalam Village, Puthanampatti (Post), **M/s.NERHU MEMORIAL COLLEGE - Master of Computer Applications (MCA) and Master of Business Administration (MBA) College** was inspected by the District Officer (Fire Dept.), Perambalur on **28.05.2021** and recommended to issue No Objection Certificate. As per his recommendations, the following conditions are to be fulfilled and this **"NO OBJECTION CERTIFICATE"** is issued based on this regard by the Fire and Rescue Department.

CONDITIONS

01.	The Applicant must obtain necessary permission and No Objection Certificate from the Officer Concerned from other related departments.
02.	If any changes have been made in the constructed building or if the number of floors in the same building is increased, you have to apply separately and get the No Objection Certificate for the same.



03.	Fire Extinguishers to be fixed by following the guidelines of IS:2190:2010.
04.	A man-operated fire alarm to be fixed.
05.	Exits, Emergency Exit, ways to escape are to be set up by following the National Building Guidelines 2016 Part IV.
06.	Self-Glowing Exit Signage must be fixed in required places.
07.	Don't save highly inflammable materials inside the building.
08.	An OHP tank with the capacity of 1000 litres and 450 LPM Capacity Motor Pump to be set for Fire Rescue purposes.
09.	Hose Reel System to be fixed.

District Officer,
Fire Rescue services
Perambalur District.
Perambalur.


To

M/s. NEHRU MEMORIAL COLLEGE
Abinimangalam Village,
Puthanampatti Post,
Thuraiyur Taluk,
Tiruchirappalli District-621007

Copy to:

The Deputy Director, Fire Rescue Services Department,
Central Region, Tiruchirappalli.

(Transliterated)
T.V. SENTHILKUMAR MA., LL.B.
ADVOCATE,
Roll No. 2187/10,
5, Pavodi Puthukkattu St.,
Thuraiyur 621 010.

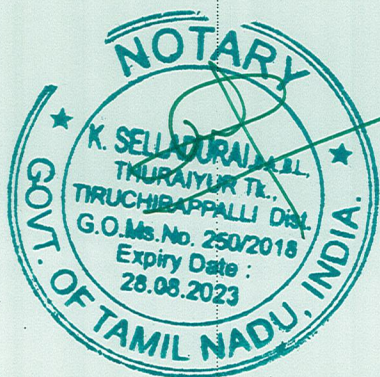

K. Selladurai
K. SELLADURAI, B.A., B.L.
ADVOCATE & NOTARY PUBLIC
Govt. of Tamilnadu - India Reg. No. G.O. Ms. No. 250/2018
Puliyampatty, Keela Kunnuppatti (Po.)
Thuraiyur (Tk.), Tiruchirappalli (Dt.) - 621 004
Cell - 98435 12376
17.6.2021